


DEVELOPERS NOTE:
 ALL DEVELOPMENTS MUST MEET A MINIMUM
 FIRE FLOW OF AT LEAST 750 GPM AT 20 PSI OR
 GREATER AS DEEMED NECESSARY BY THE CITY.

LEGEND

EXISTING 6" WATER LINE	
EXISTING 8" WATER LINE	
EXISTING 10" WATER LINE	
EXISTING 12" WATER LINE	
EXISTING 16" WATER LINE	
EXISTING 18" WATER LINE	
EXISTING 24" WATER LINE	
EXISTING 30" AND GREATER WATER LINE	
PROPOSED 8" WATER LINE	
PROPOSED 10" WATER LINE	
PROPOSED 12" WATER LINE	
PROPOSED 16" WATER LINE	

	ISOLATION VALVE
	BOOSTER PUMP
BOOSTER PUMP OPERATING CONDITIONS	
STATE BARN	~ 1,200 GPM @ 35' ~ 25 HP
DR. BRAMBLETT	~ 600 GPM @ 70' ~ 20 HP

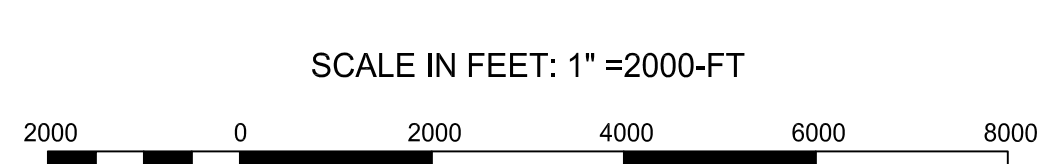

CEC
 CIVIL ENGINEERING CONSULTANTS, INC.
 Civil & Environmental Engineering
 1225 Johnson Ferry Road, Suite 855
 Marietta, Georgia 30068
 (770) 977-5747 • Fax (770) 977-4289
 cecinc@mindspring.com

City of Cumming
 Department of Utilities - Distribution and Collection Division

**WATER MASTER PLAN
 MAJOR DISTRIBUTION NETWORK**

FEBRUARY 2008