


PLAN

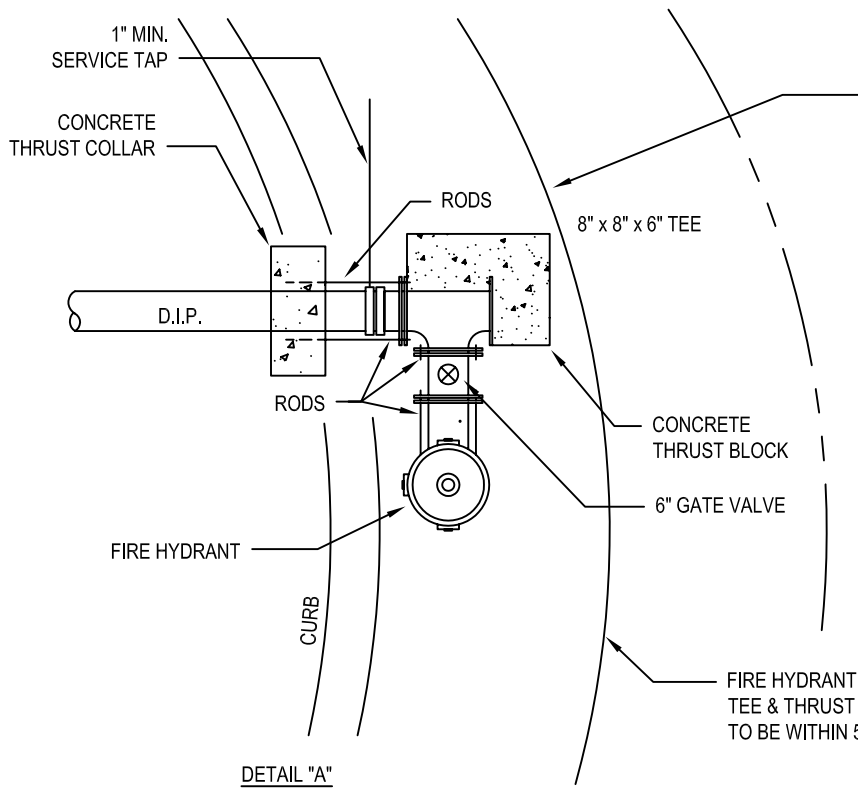

DETAIL "A"

FIRE HYDRANT, VALVE, TEE, & THRUST BLOCK MUST BE WITHIN 5' OF CURB

NOTE:

1. FIRE HYDRANT TO BE LOCATED WITHIN 5' OF CURB.
2. CONTRACTOR TO PROVIDE DOUBLE STRAP TAPPING SADDLES FOR SERVICE STUBS ON BOTH SIDES OF CONNECTION.

FIRE HYDRANT, VALVE, TEE & THRUST BLOCK TO BE WITHIN 5' OF CURB

REVISIONS

City of Cumming
 Department of Utilities - Distribution and Collection Division

CUL-DE-SAC WATER MAIN
TERMINATION
FOR SUBDIVISIONS



W-23