


DEPTH OF WATER MAIN SHALL BE 3-FT. IF MAIN IS 6"-10" IN DIAMETER. DEPTH OF WATER MAIN SHALL BE 4-FT. IF MAIN IS OVER 12" IN DIAMETER.

**CROWNED ROAD
DITCH & EMBANKMENT**

ACTUAL LOCATION DEPENDS ON SLOPE OF BANK. IF IN DOUBT, INSPECTOR WILL DETERMINE APPROPRIATE LOCATION.

SEE DRWG. W-45 FOR INSTALLATION REQUIREMENTS

NOTE: CITY WATER INSPECTOR MUST APPROVE LOCATION OF ALL WATER METERS

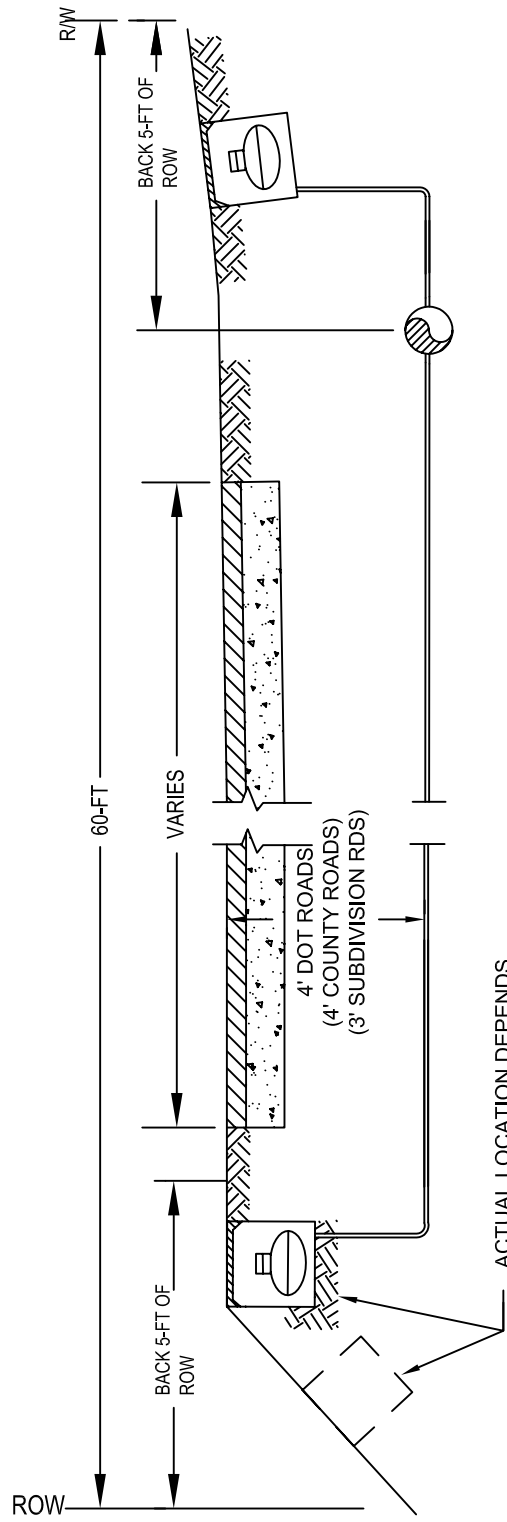

ACTUAL LOCATION DEPENDS ON SLOPE OF BANK. IF IN DOUBT, CITY WATER INSPECTOR WILL DETERMINE APPROPRIATE LOCATION.

**FLAT OR CONCRETE ROAD
SLIGHT DITCH & EMBANKMENT**

SEE DRWG. W-45 FOR INSTALLATION REQUIREMENTS

REVISIONS

City of Cumming

Department of Utilities - Distribution and Collection Division

METER LOCATIONS 3/4-INCH - 2-INCH ALONG COUNTY AND DOT ROADS



W-44