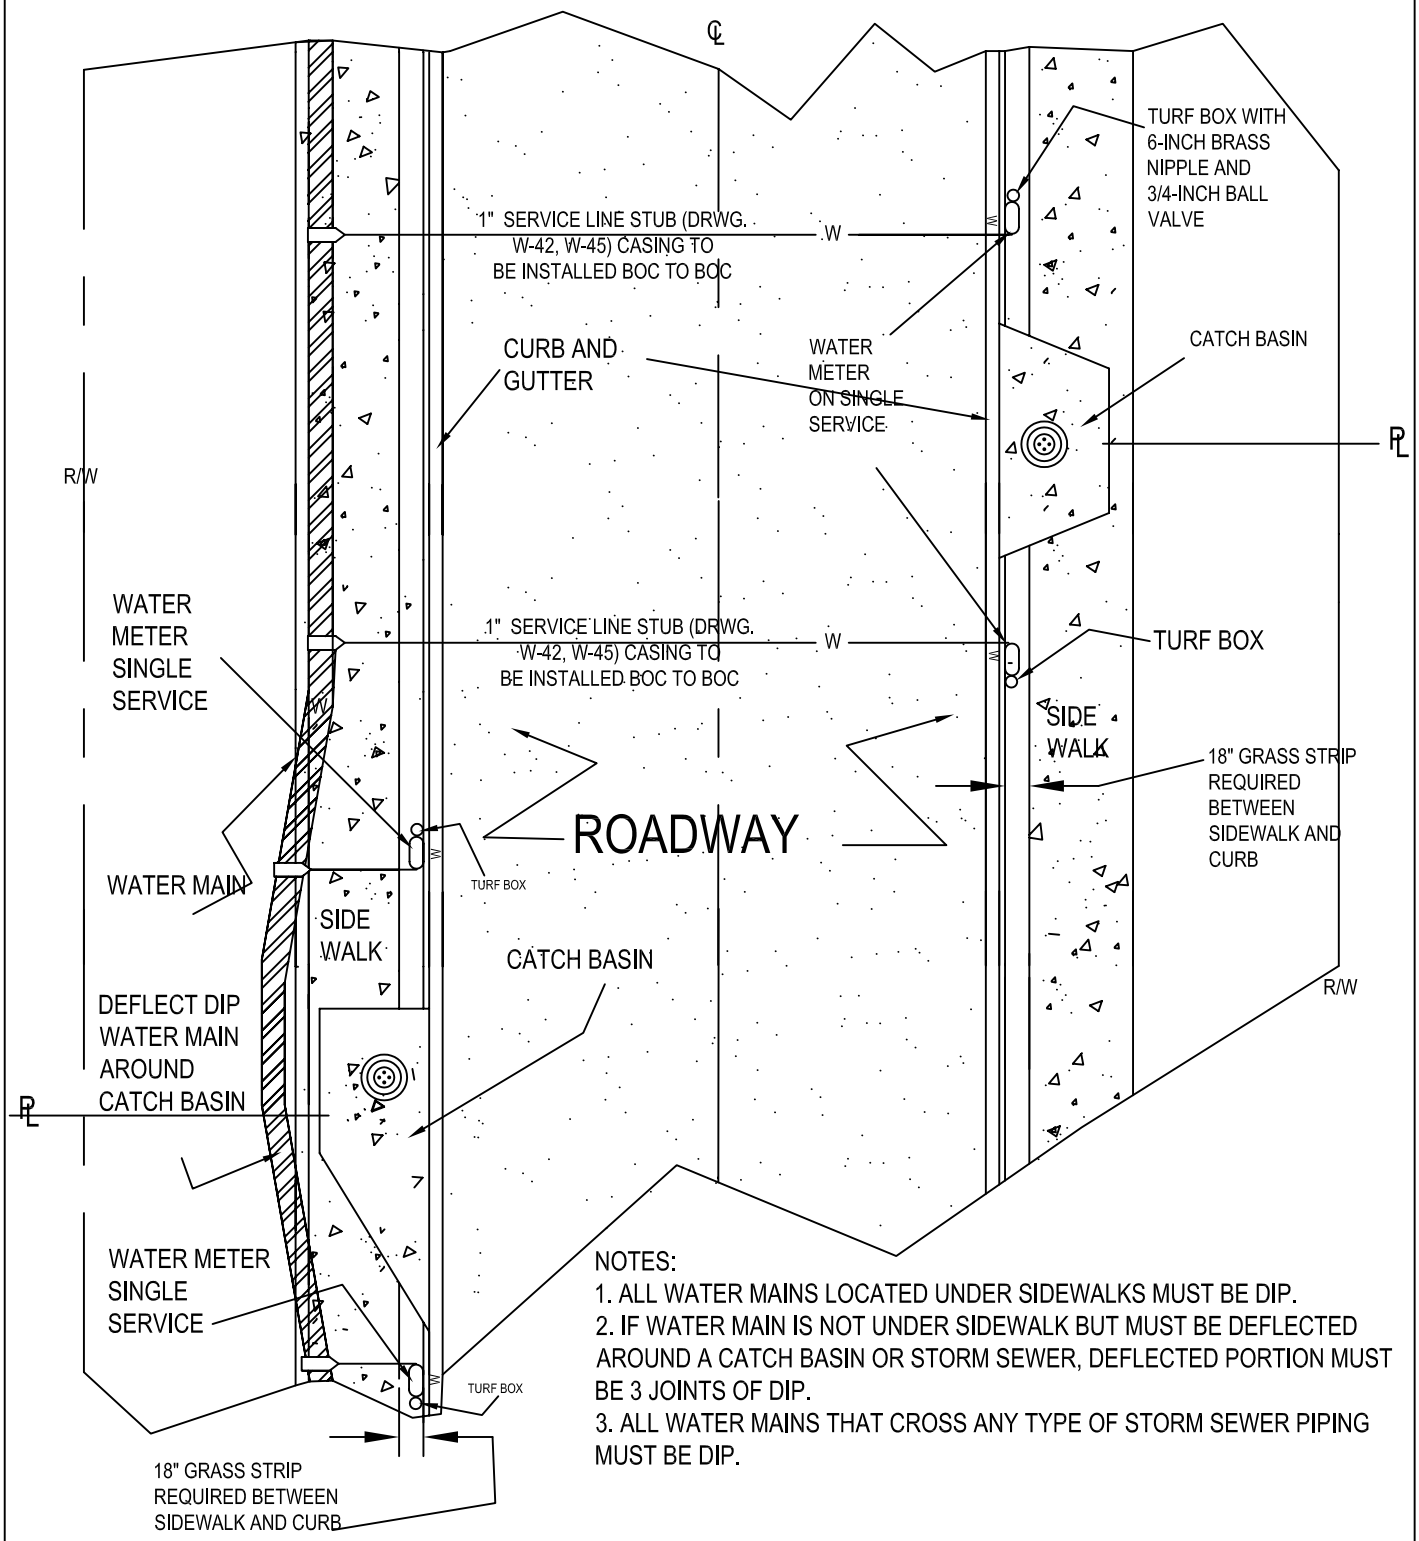

NOTES:

1. ALL WATER MAINS LOCATED UNDER SIDEWALKS MUST BE DIP.
2. IF WATER MAIN IS NOT UNDER SIDEWALK BUT MUST BE DEFLECTED AROUND A CATCH BASIN OR STORM SEWER, DEFLECTED PORTION MUST BE 3 JOINTS OF DIP.
3. ALL WATER MAINS THAT CROSS ANY TYPE OF STORM SEWER PIPING MUST BE DIP.

REVISIONS

City of Cumming

Department of Utilities - Distribution and Collection Division

WATER SYSTEM CONFIGURATION IN RELATION TO CATCH BASINS LOCATED ON THE PROPERTY LINE

W-47