SURFACE COURSE NOT
INCLUDED IN SERVICE LINE
BACKFILLING WORK

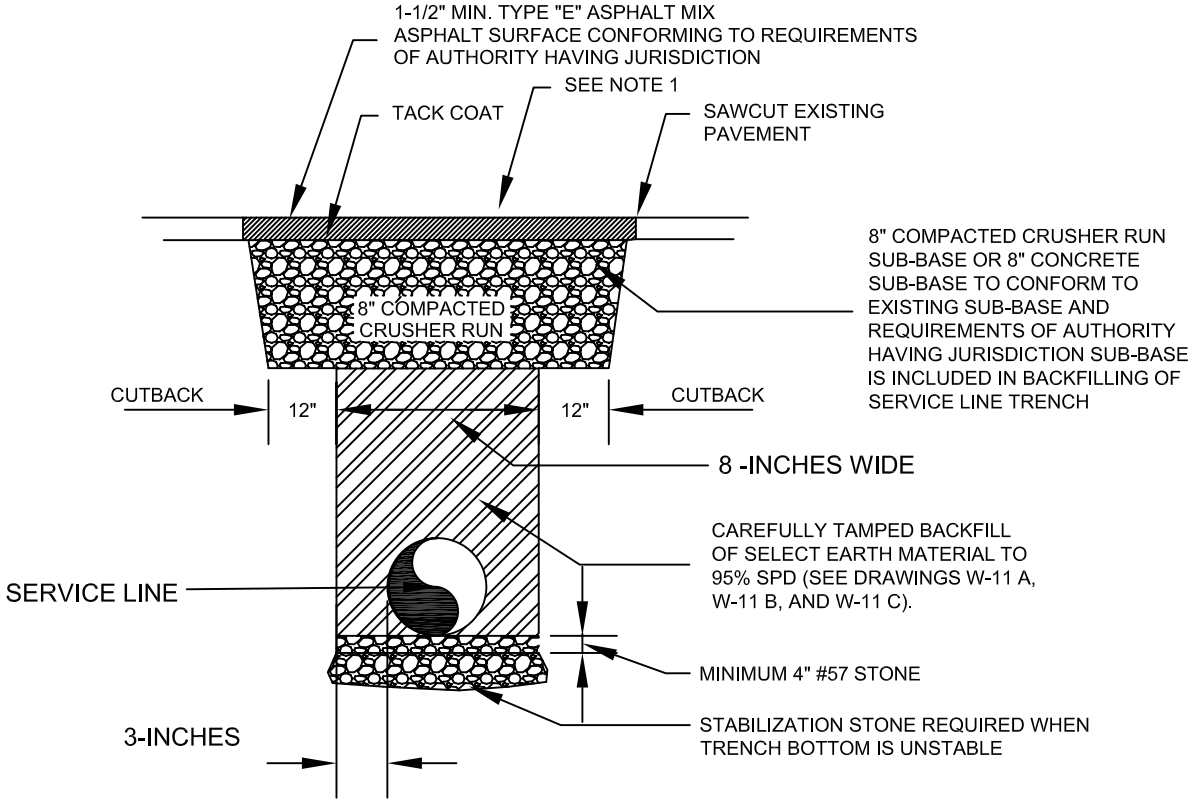

N.T.S.

NOTES:

1. WHERE ROADWAY IS CONCRETE, NO ASPHALT SURFACE IS REQUIRED, CONCRETE SUB-BASE SHALL BE POURED LEVEL WITH EXISTING ROAD SURFACE WHILE MAINTAINING 8-INCH THICKNESS

2. BACKFILL TO BE PLACED AT 4" - 12" LAYERS, AND TAMPED PROPERLY IN ACCORDANCE WITH AWWA C600 (LATEST VERSION)

REVISIONS

City of Cumming

Department of Utilities - Distribution and Collection Division

PAVEMENT CUT REPAIRS
3/4 -INCH TO 2-INCH SLEEVE LINES

W-49