


NOTES:

1. DUAL CHECK VALVE BACKFLOW DEVICE TO BE INSTALLED BY CITY.
2. EXPANSION CONNECTION TO BE INSTALLED BY CITY.
3. 5/8" x 3/4" RADIO READ WATER METER TO BE INSTALLED BY CITY.
4. METER VALVE: ANGLE PLUG TYPE WITH 3/4" CTS CONNECTION (FORD PACK JOINT OR A.Y. McDONALD MAC-PAK)
5. HORIZONTAL OUTLET WITH 3/4" FEMALE IRON PIPE THREAD.

PLASTIC TURF BOX WITH LID.
TYPICALLY 6-INCHES IN DIAMETER
AND 9.25-INCHES DEEP

3/4-INCH BRASS CUT-OFF BY WATTS
PART NUMBER FBV-SS-TH OR
A.Y.MCDONALD PART NO. 2037T

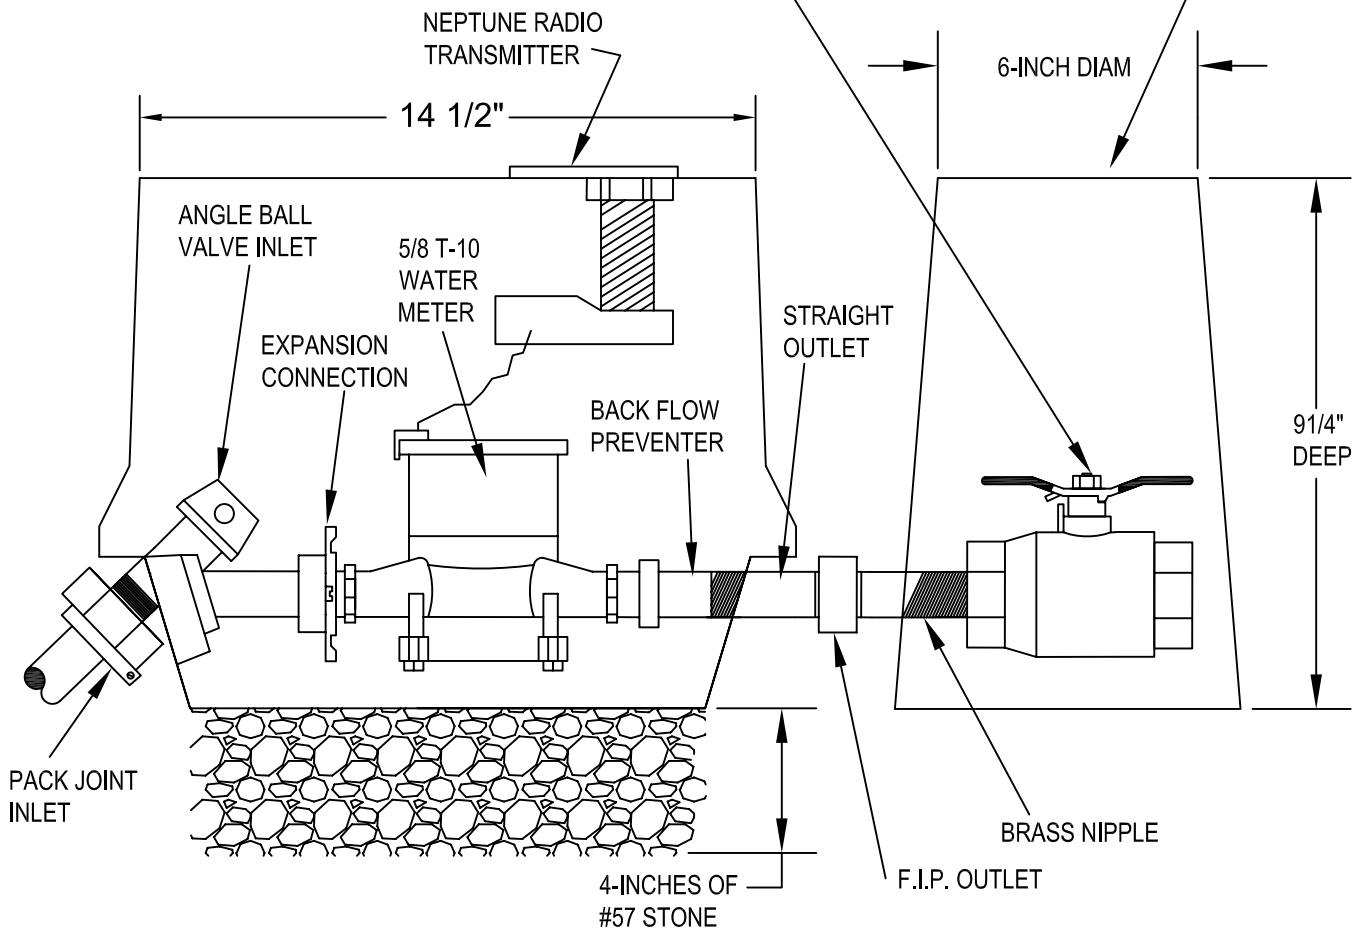

Accepted Brands: A.Y. McDonald Manufacturing Company Longboxes or Ford Long Yokeboxes.

REVISIONS

City of Cumming
Department of Utilities - Distribution and Collection Division

5/8" x 3/4" CAST IRON METER BOX
WITH ANGLE BALL VALVE INLET X
STRAIGHT OUTLET



W-57