


5'-0" MINIMUM FROM EDGE OF
STREAM BANK TO EDGE OF
CONCRETE ENCASEMENT
(TYPICAL)

3-FT MINIMUM BELOW
STREAM BED

RIPRAP

DUCTILE IRON
CARRIER PIPE

CONCRETE ENCASEMENT
SEE DETAIL W-68

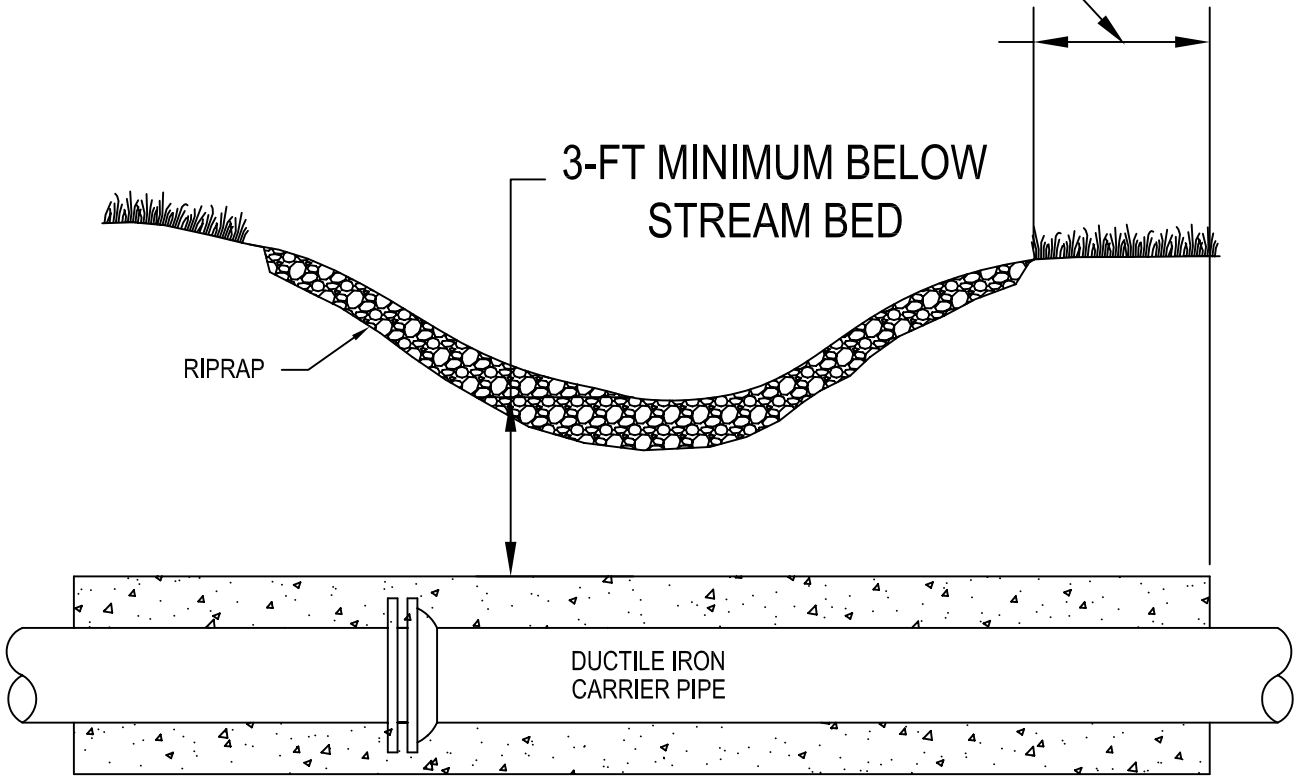

REVISIONS

City of Cumming
Department of Utilities - Distribution and Collection Division

STREAM CROSSING



W-58