1. CONCRETE BLOCKING ON ALL TEES AND BENDS.

2. MJ BENDS WITH "MEGA-LUG" TYPE GLANDS.

3a. MJ TEES WITH "MEGA-LUG" TYPE GLANDS.

3b. MJ TEES WITH "MEGA-LUG" TYPE GLANDS OR "FOSTER ADAPTERS".

4. MJ GATE VALVES.

5. "FOSTER ADAPTERS".

6. "ROMA GRIP" RESTRAINED MJ/FLANGE COUPLING ADAPTERS.

7. FLANGE TYPE NON-RISING STEM (OS & Y) GATE VALVES.

8. "NEPTUNE" BRONZE STRAINER.

9. "CONBRACO MODEL DC" DOUBLE CHECK VALVE.

10. "NEPTUNE TRU/FLO" COMPOUND METER WITH DUAL PORT R900V2 TRANSMITTER KIT.

11. ¾" ALL THREADED ROD & ¾" EYE BOLTS.

12. CONCRETE VAULT INSIDE DIMENSIONS 60" L x 36" W x 44" H WITH 2'-0" x 2'-0" ALUM. HATCH, 4" THICK WALLS AND 6" THICK TOP.

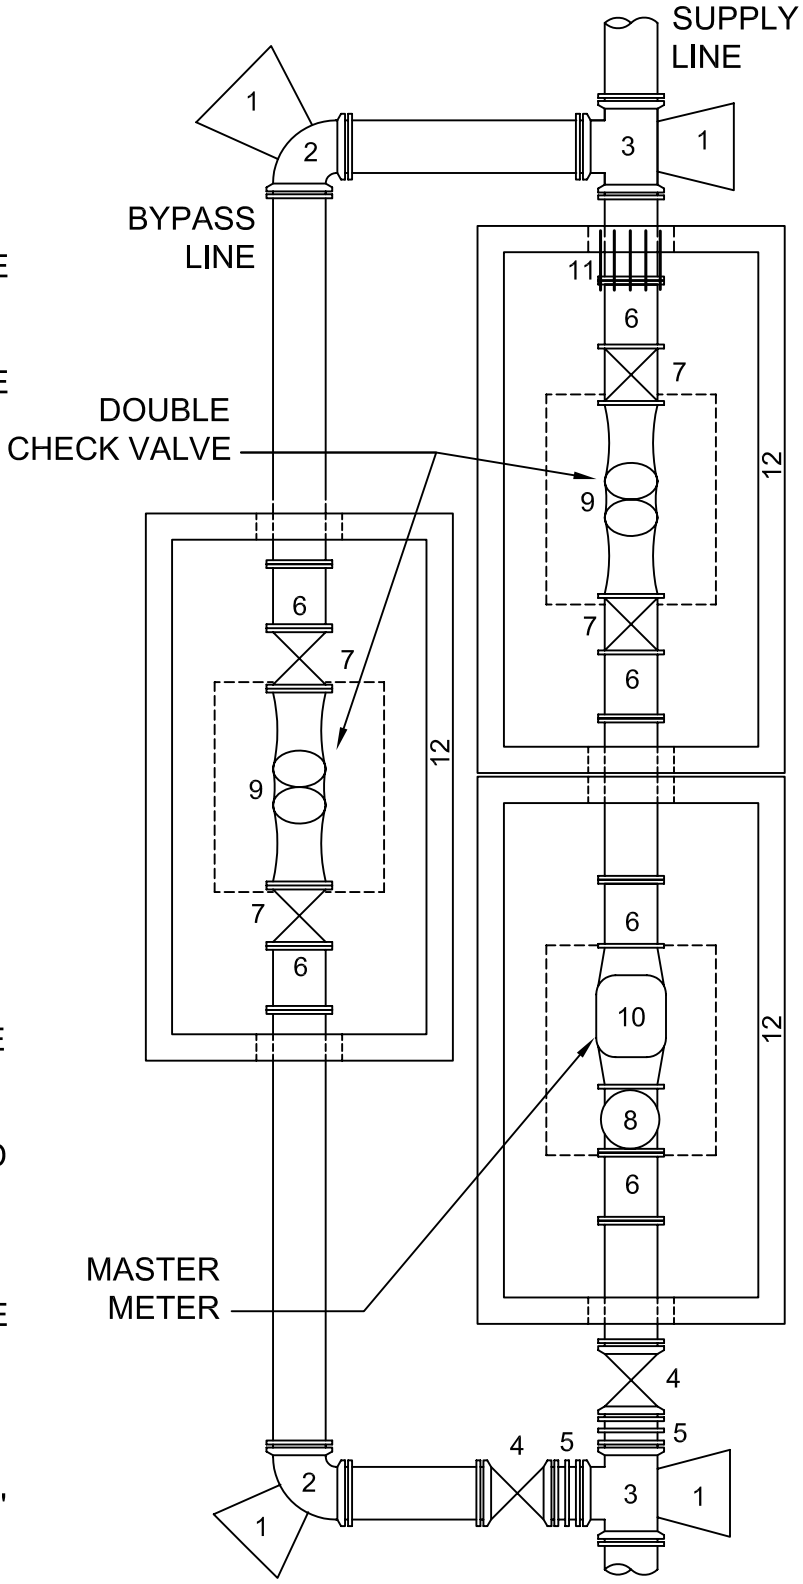

REVISIONS

City of Cumming

Department of Utilities - Distribution and Collection Division

MASTER METER WITH BYPASS DETAIL FOR 3" AND 4"

W-73